

Unit ID **Gas turbine**  
 Component **Lubricating oil**  
 Current sample number **1700834**



OELCHECK GmbH · Kerschelweg 28 · 83098 Brannenburg

Machine type: **Gas turbine**  
 Manufacturer: **ABC**  
 Oil brand name: **Mobil DTE 832**  
 Oil quantity in system: **4300 l**

Example report  
 Analysis scope: Turbine Oil Kit 7

### Diagnosis for the current laboratory values

No wear metals present in the sample. Viscosity and additive levels are in the normal range. The air release property is at the level of fresh oil. The foaming tendency is the same as that of fresh oil. If no oil change has happened yet, it is possible to continue using the oil under similar operating conditions and under continuation of the usual maintenance schedule. I recommend that you send the next sample at the next service interval or at your regular inspection for trend analysis.

Dipl.-Ing. Stefan Mitterer

### Sample Rating




**normal**

ANALYSIS RESULTS			Current sample	Previous samples	
LAB NUMBER			1700834	1700835	
SAMPLE RATING					
Date tested			31.10.2023	25.11.2022	
Date of sample taken			27.10.2023	14.11.2022	
Date of last oil change			24.07.2023	01.10.2017	
Top-up since change	l		200	2400	
Operating time since change	h		665	32856	
Total operating time	h		38211	32856	
Oil changed			no	no	
<b>WEAR</b>					
Iron	Fe	mg/kg	0	0	
Chrom	Cr	mg/kg	0	0	
Tin	Sn	mg/kg	0	0	
Aluminum	Al	mg/kg	0	0	
Nickel	Ni	mg/kg	0	0	
Copper	Cu	mg/kg	0	0	
Lead	Pb	mg/kg	0	0	
Molybdenum	Mo	mg/kg	0	0	
PQ index	-		< 25	< 25	
<b>CONTAMINATION</b>					
Silicon	Si	mg/kg	0	0	
Potassium	K	mg/kg	0	0	
Sodium	Na	mg/kg	0	0	
Lithium	Li	mg/kg	0	0	
Water K. F.	ppm		85	91	
<b>OIL CONDITION</b>					
Viscosity at 40°C	mm²/s		32.46	32.05	
Viscosity at 100°C	mm²/s		5.80	5.76	
Viscosity index	-		122	122	
Oxidation	A/cm		1	1	
IR index	-		99.25	99.10	
Color	Color index		1.0	4.0	
<b>ADDITIVES</b>					
Calcium	Ca	mg/kg	2	0	
Magnesium	Mg	mg/kg	0	0	
Boron	B	mg/kg	1	0	
Zinc	Zn	mg/kg	1	0	
Phosphorus	P	mg/kg	1099	1155	
Barium	Ba	mg/kg	0	0	
Sulphur	S	mg/kg	56	140	


Bottle and cap



Infrared Spectrum

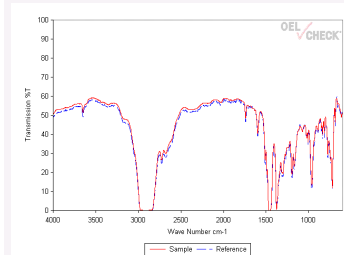

RULER Diagram

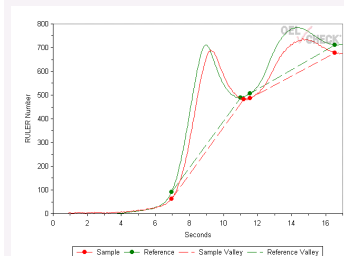

# LAB REPORT

Unit ID **Gas turbine**  
 Component **Lubricating oil**  
 Current sample number **1700834**




Machine type: **Gas turbine**  
 Manufacturer: **ABC**  
 Oil brand name: **Mobil DTE 832**  
 Oil quantity in system: **4300 l**

Example report  
 Analysis scope: Turbine Oil Kit 7

ANALYSIS RESULTS		Current sample	Previous samples	
<b>LAB NUMBER</b>		<b>1700834</b>	1700835	
<b>SAMPLE RATING</b>		✓	✓	
Date tested		<b>31.10.2023</b>	25.11.2022	
Date of sample taken		<b>27.10.2023</b>	14.11.2022	
Date of last oil change		<b>24.07.2023</b>	01.10.2017	
Top-up since change	l	<b>200</b>	2400	
Operating time since change	h	<b>665</b>	32856	
Total operating time	h	<b>38211</b>	32856	
Oil changed		<b>no</b>	no	
<b>ADDITIONAL TESTS</b>				
AN / NN	mgKOH/g	<b>&lt; 0.10</b>	0.12	
Air-release properties	min	<b>2.4</b>	2.8	
Foam test seq. I	ml/ml	<b>140/0</b>	220/0	
Cleanliness class	ISO 4406	<b>15/13/10</b>	16/14/10	
>4µm (ISO)	Particles/100ml	<b>30213</b>	61254	
>6µm (ISO)	Particles/100ml	<b>7547</b>	14587	
>14µm (ISO)	Particles/100ml	<b>889</b>	888	
Antioxidant 1 - RULER	%	<b>91.3</b>	58.1	
Antioxidant 2 - RULER	%	<b>84.7</b>	49.8	
Phenolic antioxidant FT-IR	%	<b>94.1</b>	66.0	

Air-release properties

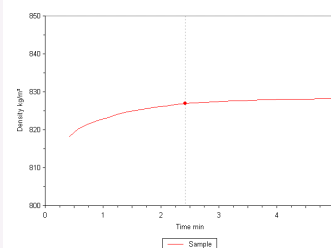

Unit ID **Gas turbine**  
 Component **Lubricating oil**  
 Current sample number **1700834**

+49 8034-9047-210

page 3 of 3

Machine type: **Gas turbine**  
 Manufacturer: **ABC**  
 Oil brand name: **Mobil DTE 832**  
 Oil quantity in system: **4300 l**

Example report  
 Analysis scope: Turbine Oil Kit 7

### Evaluation of the oxidation inhibitors

In comparison with the reference sample, there are no significant changes of antioxidant additives (oxidation inhibitors).

Dipl.-Ing. Stefan Mitterer

ANALYSIS RESULTS		Current sample
<b>LAB NUMBER</b>		<b>1700834</b>
Date tested		31.10.2023
Date of sample taken		27.10.2023
Date of last oil change		24.07.2023
Top-up since change	l	200
Operating time since change	h	665
Total operating time	h	38211
Oil changed		no

Antioxidant/RULER		
Antioxidant 1 - RULER	%	91,3
Antioxidant 2 - RULER	%	84,7

Antioxidant/FT-IR		
Phenolic antioxidant FT-IR	%	94,1

