Unit ID Steam turbine

Component Lubricating oil 10T

Lab number 1702851





page 1 of 4

OELCHECK GmbH · Kerschelweg 28 · 83098 Brannenburg

Example report

Analysis scope: Turbine Oil Kit 10

Machine type: EG49/8/8

Manufacturer: Siemens/Bergmann Borsig

Sample from: Lubricating oil
Oil brand name: Aral Kosmol TF 46

Oil quantity in system: 3000 I

Diagnosis for the current laboratory values

No wear metals present in the sample. The oil cleanliness is within the expected limits. The foaming tendency has increased slightly. The air release property has increased slightly. Please observe further changes with the next sample. I recommend that you send the next sample at the next service interval or at your regular inspection for trend analysis.

Dipl.-Ing. (FH) Stefan Mitterer


Sample Rating




Caution

ANALYSIS RESULTS					
ANALYSIS RESULTS			Current sample		Previous samples
LAB NUMBER			1702851		
SAMPLE RATING			i		
Date tested			11.05.2023		
Date of sample taken			02.05.2023		
Date of last oil change			01.09.2015		
Top-up since change			-		
Operating time since change	ge	h	59805		
Total operating time		h	351596		
Oil changed			no		
WEAR					
Iron	Fe	mg/kg	0		
Chrome	Cr	mg/kg	0		
Tin	Sn	mg/kg	0		
Aluminum	Al	mg/kg	0		
Nickel	Ni	mg/kg	0		
Copper	Cu	mg/kg	0		
Lead	Pb	mg/kg	0		
Molybdenum	Мо	mg/kg	0		
PQ index	-		< 25		
CONTAMINATION				 	
Silicon	Si	mg/kg	0		
Potassium	K	mg/kg	1		
Sodium	Na	mg/kg	0		
Lithium	Li	mg/kg	0		
Water K. F.	ppm		97		
OIL CONDITION					
Viscosity at 40°C	mm²/s		44.96		
Viscosity at 100°C	mm²/s		6.80		
Viscosity index	-		106		
Oxidation	A/cm		1		
IR index	-		99.76		
Color	Color inde	X	1.5	 	
ADDITIVES	_				
Calcium	Ca	mg/kg	0		
Magnesium	Mg	mg/kg	0		
Boron	В	mg/kg	0		
Zinc	Zn	mg/kg	0		
Phosphorus	P	mg/kg	12		
Barium	Ва	mg/kg	0 236		
Sulphur	S	mg/kg	236		







Unit ID Steam turbine

Component Lubricating oil 10T

Lab number 1702851





page 2 of 4

Machine type: EG49/8/8

Manufacturer: Siemens/Bergmann Borsig


Sample from: Lubricating oil
Oil brand name: Aral Kosmol TF 46

Oil quantity in system: 3000 I

rt
)

Analysis scope: Turbine Oil Kit 10

ANALYSIS RESULTS	3	Current sample
LAB NUMBER		1702851
SAMPLE RATING		i
Date tested		11.05.2023
Date of sample taken	02.05.2023	
Date of last oil change	01.09.2015	
Top-up since change		-
Operating time since cha	nge h	59805
Total operating time	h	351596
Oil changed		no
ADDITIONAL TESTS		
AN / NN	mgKOH/g	0.13
MPC		8.30
Air-release properties	min	6.3
Water separation (steam)	s	111
Foam test seq. I	ml/ml	500/0
Cleanliness class	ISO 4406	17/15/11
A: >4μm = ISO >4μm	Particles/100ml	121520
B: >6μm = ISO >6μm	Particles/100ml	23180
C: >14µm = ISO >14µm	Particles/100ml	1910
D: >21µm	Particles/100ml	790
E: >38µm	Particles/100ml	130
F: >70µm	Particles/100ml	40
Cleanliness class	SAE AS 4059	8A
Steel corrosion	DIN ISO 7120/A	pass
Antioxidant 1 - RULER	%	87.3
Antioxidant 2 - RULER	%	49.9



Unit ID Steam turbine

Component Lubricating oil 10T

Lab number 1702851





page 3 of 4

Machine type: EG49/8/8

Manufacturer: Siemens/Bergmann Borsig

Sample from: Lubricating oil
Oil brand name: Aral Kosmol TF 46


Oil quantity in system: 3000 I

Example report

Analysis scope: Turbine Oil Kit 10


Evaluation of the oxidation inhibitors

Compared to the reference sample, only a slight degradation of antioxidants is visible. There is still enough aging protection in the oil. **Dipl.-Ing. (FH) Stefan Mitterer**

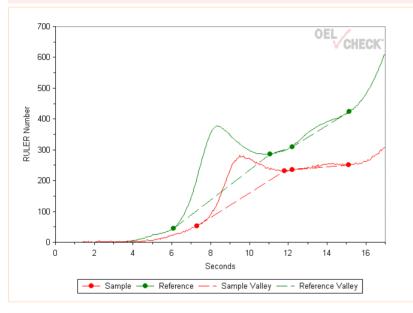

ANALYSIS RESULTS	Current sample	
LAB NUMBER		1702851
Date tested		11.05.2023
Date of sample taken		02.05.2023
Date of last oil change		01.09.2015
Top-up since change		-
Operating time since change	h	59805
Total operating time	h	351596
Oil changed		no

Antioxidant/RULER		
Antioxidant 1 - RULER	%	87,3
Antioxidant 2 - RULER	%	49,9

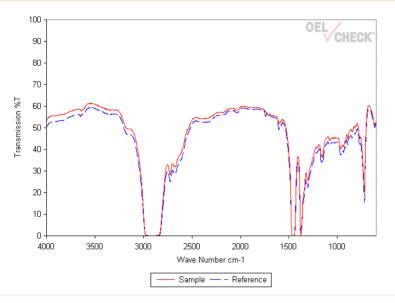

Antioxidant/FT-IR

Unit ID Steam turbine

Component Lubricating oil 10T

Lab number 1702851





page 4 of 4

Machine type: EG49/8/8

Manufacturer: Siemens/Bergmann Borsig

Sample from: Lubricating oil
Oil brand name: Aral Kosmol TF 46

Oil quantity in system: 3000 I


Example report

Analysis scope: Turbine Oil Kit 10

Diagnosis of the MPC test

The MPC value is within a normal range. There is no risk for the formation of varnish.

Dipl.-Ing. (FH) Stefan Mitterer

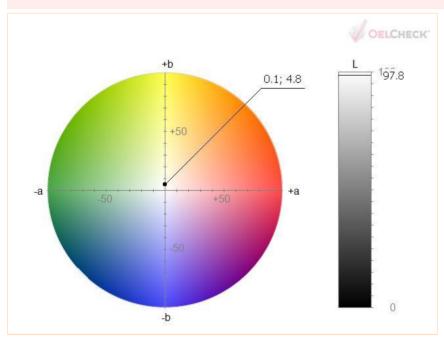

ANALYSIS RESULTS	Current sample	
LAB NUMBER		1702851
Date tested		11.05.2023
Date of sample taken		02.05.2023
Date of last oil change		01.09.2015
Top-up since change		-
Operating time since change	h	59805
Total operating time	h	351596
Oil changed		no

MPC test	
MPC	8,30
Luminance L	97,80
Redness index a	0,10
Yellowness index b	5,80

