

Unit ID **Water turbine**
 Component **Lubricating oil**
 Current sample number **1704502**

+49 8034-9047-210

page 1 of 3

OELCHECK GmbH · Kerschelweg 28 · 83098 Brannenburg

Machine type: **VZ 71**
 Manufacturer: **Escher Wyss**
 Oil brand name: **Shell Turbo T 46**
 Oil quantity in system: **3500 l**

Example report
 Analysis scope: Turbine Oil Kit 6

Diagnosis for the current laboratory values

Wear metals are only present in negligible concentrations. Hardly any abrasive or corrosive wear is therefore visible. The cleanliness class of the oil complies with the requirements. The water content is within the normal range. The water separability is within the expected range. All the other data detected are within the permissible or expected value range. If no oil change has happened yet, it is possible to continue using the oil under similar operating conditions and under continuation of the usual maintenance schedule. I recommend that you send the next sample at the next service interval or at your regular inspection for trend analysis.



Dipl.-Ing. Andy Böhme (CLS)

Sample Rating



normal

ANALYSIS RESULTS			Current sample	1 previous samples not shown		
LAB NUMBER			1704502	1704507	1704508	1704509
SAMPLE RATING			✓	✓	✓	✓
Date tested			27.07.2021	20.07.2020	28.02.2019	07.12.2018
Date of sample taken			20.07.2021	12.07.2020	23.02.2019	27.11.2018
Date of last oil change			21.05.2013	21.05.2013	21.05.2013	21.05.2013
Top-up since change			-	-	-	-
Operating time since change h			71520	62710	50830	48690
Total operating time			-	-	-	-
Oil changed			no	no	no	no
WEAR						
Iron	Fe	mg/kg	0	0	0	0
Chrom	Cr	mg/kg	0	0	0	0
Tin	Sn	mg/kg	0	0	0	0
Aluminum	Al	mg/kg	0	0	0	0
Nickel	Ni	mg/kg	0	0	0	0
Copper	Cu	mg/kg	0	1	0	0
Lead	Pb	mg/kg	1	0	0	0
Molybdenum	Mo	mg/kg	0	0	0	0
Manganese	Mn	mg/kg	0	0	0	0
PQ index	-		< 25	< 25	< 25	< 25
CONTAMINATION						
Silicon	Si	mg/kg	0	0	0	0
Potassium	K	mg/kg	0	0	0	1
Sodium	Na	mg/kg	0	1	0	0
Lithium	Li	mg/kg	0	0	0	0
Water K. F.	ppm		< 30	< 30	< 30	40
OIL CONDITION						
Viscosity at 40°C	mm²/s		46.11	45.81	45.59	46.09
Viscosity at 100°C	mm²/s		6.97	6.95	6.95	7.03
Viscosity index	-		108	108	109	110
Oxidation	A/cm		1	1	1	1
IR index	-		99.94	99.89	98.26	-
Color	Color index		0.5	0.5	0.5	0.5
ADDITIVES						
Calcium	Ca	mg/kg	0	0	1	0
Magnesium	Mg	mg/kg	0	0	0	0
Boron	B	mg/kg	0	0	0	0
Zinc	Zn	mg/kg	2	2	0	1
Phosphorus	P	mg/kg	0	0	0	0
Barium	Ba	mg/kg	0	0	0	0
Sulphur	S	mg/kg	< 10	< 10	41	< 10

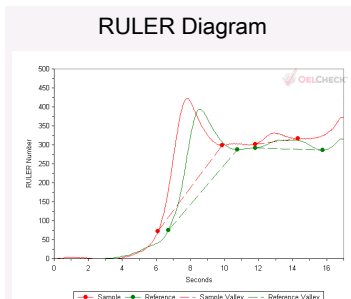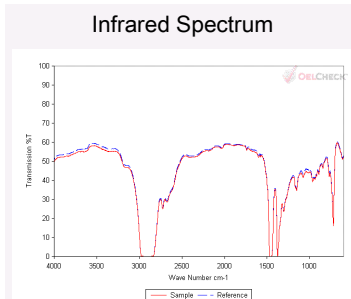

LAB REPORT

Unit ID **Water turbine**
 Component **Lubricating oil**
 Current sample number **1704502**


+49 8034-9047-210


page 2 of 3

Machine type: **VZ 71**
 Manufacturer: **Escher Wyss**
 Oil brand name: **Shell Turbo T 46**
 Oil quantity in system: **3500 l**

Example report
 Analysis scope: Turbine Oil Kit 6

ANALYSIS RESULTS	Current sample	1 previous samples not shown			
LAB NUMBER	1704502	1704507	1704508	1704509	
SAMPLE RATING					
Date tested	27.07.2021	20.07.2020	28.02.2019	07.12.2018	
Date of sample taken	20.07.2021	12.07.2020	23.02.2019	27.11.2018	
Date of last oil change	21.05.2013	21.05.2013	21.05.2013	21.05.2013	
Top-up since change	-	-	-	-	
Operating time since change	h 71520	62710	50830	48690	
Total operating time	-	-	-	-	
Oil changed	no	no	no	no	
ADDITIONAL TESTS					
AN / NN	mgKOH/g	0.06	0.05	0.08	0.07
Water separation (steam)	s	101	86	62	59
Cleanliness class	ISO 4406	16/14/11	17/15/12	17/15/12	17/15/12
A: >4µm = ISO >4µm	Particles/100ml	56897	83506	72319	70341
B: >6µm = ISO >6µm	Particles/100ml	14632	22074	22251	26441
C: >14µm = ISO >14µm	Particles/100ml	1065	2139	2853	3695
D: >21µm	Particles/100ml	328	592	947	1254
E: >38µm	Particles/100ml	24	114	97	41
F: >70µm	Particles/100ml	0	0	0	15
Cleanliness class	SAE AS 4059	7A	7A	7A	8D
Antioxidant 1 - RULER	%	107.0	108.8	103.8	96.6
Antioxidant 2 - RULER	%	49.2	52.8	69.7	60.4

Air-release properties

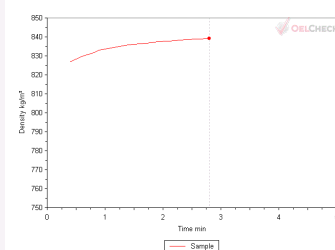

Unit ID **Water turbine**
 Component **Lubricating oil**
 Current sample number **1704502**

+49 8034-9047-210

page 3 of 3


Machine type: **VZ 71**
 Manufacturer: **Escher Wyss**
 Oil brand name: **Shell Turbo T 46**
 Oil quantity in system: **3500 l**

Example report
 Analysis scope: Turbine Oil Kit 6

Evaluation of the oxidation inhibitors


Compared to the reference sample, only a slight degradation of antioxidants is visible. There is still enough aging protection in the oil.

Dipl.-Ing. Andy Böhme (CLS)

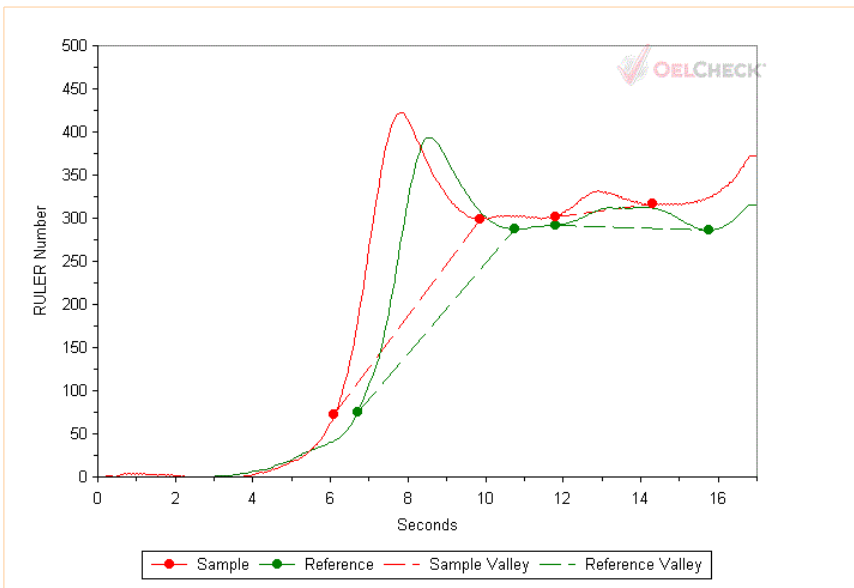

ANALYSIS RESULTS		Current sample
LAB NUMBER		1704502
Date tested		27.07.2021
Date of sample taken		20.07.2021
Date of last oil change		21.05.2013
Top-up since change		-
Operating time since change	h	71520
Total operating time		-
Oil changed		no

Antioxidant/RULER		
Antioxidant 1 - RULER	%	107,0
Antioxidant 2 - RULER	%	49,2
Electrolyte solution		Green
Sample volume	µl	400

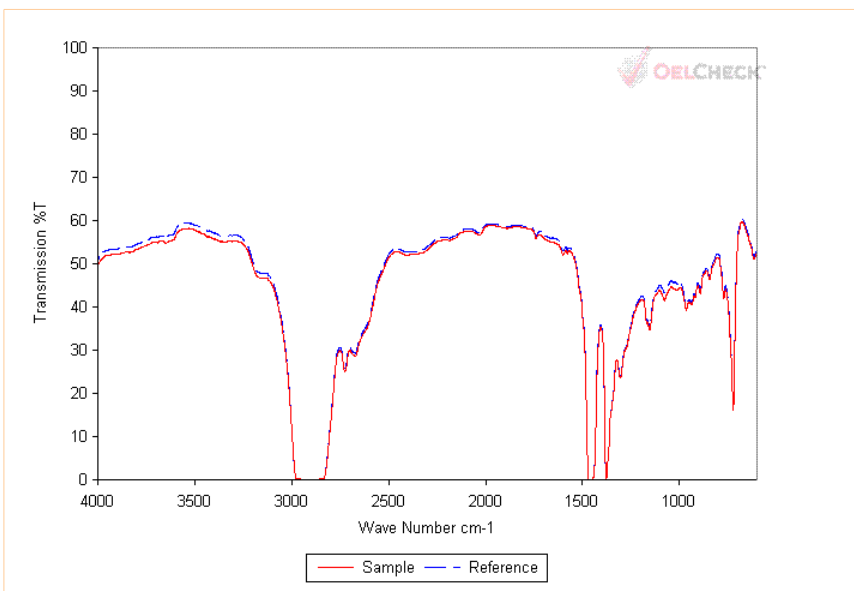

Antioxidant/FT-IR

